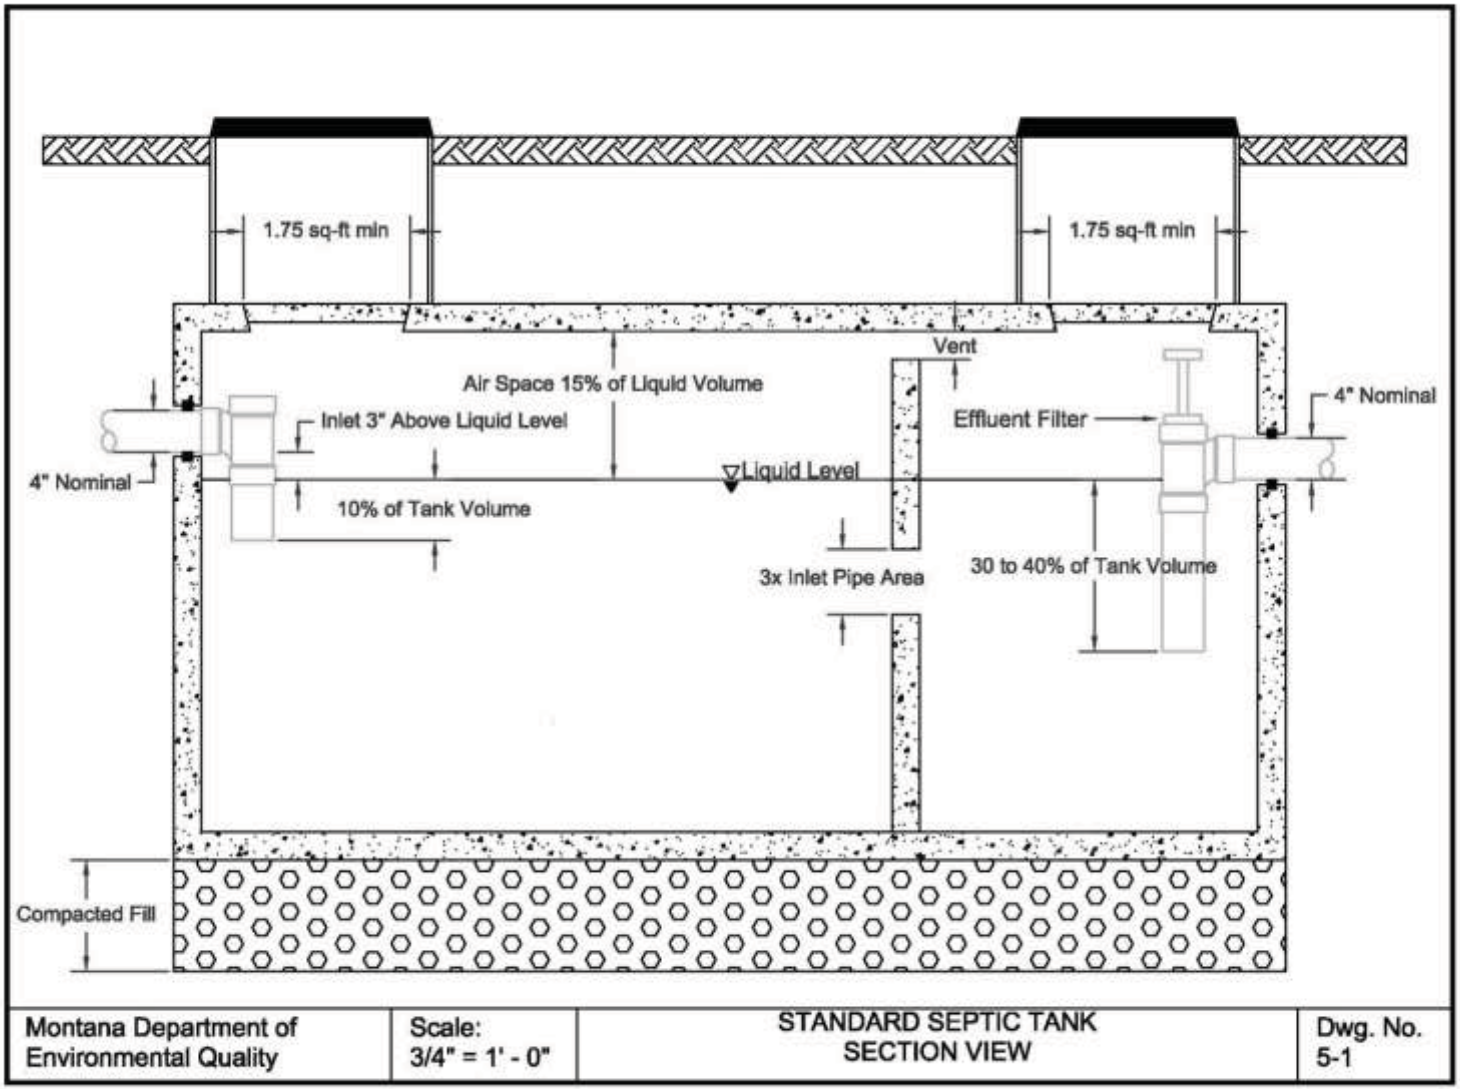
1.75 sq-ft min
1.75 sq-ft min
Vent
Air Space 15% of Liquid Volume
Inlet 3" Above Liquid Level
Effluent Filter
4" Nominal
4" Nominal
Liquid Level
10% of Tank Volume
3x Inlet Pipe Area
30 to 40% of Tank Volume
Compacted Fill
Montana Department of Environmental Quality
Scale: 3/4" = 1' - 0"
STANDARD SEPTIC TANK SECTION VIEW
Dwg. No. 5-1